





T H E G C M E T H O D

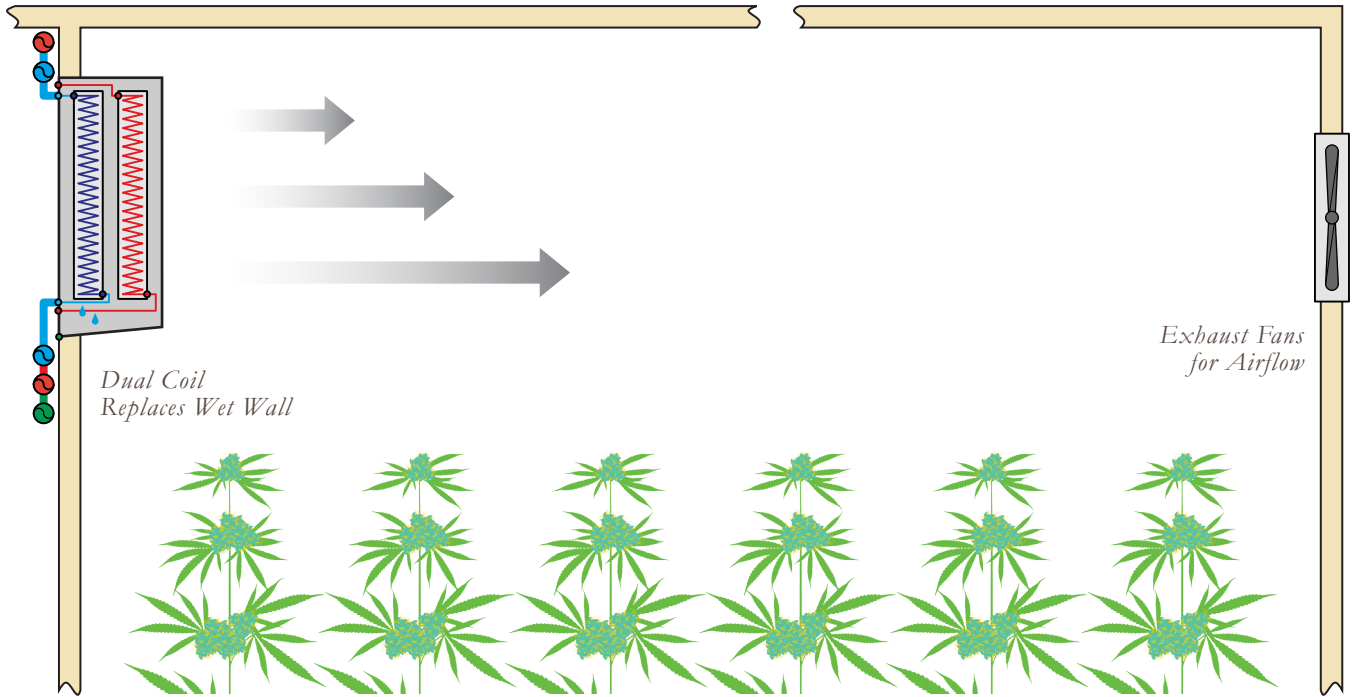

GREENHOUSE - SECTION VIEW

- ✗ Existing Louvres are Removed or Blocked
- ✗ Wet Wall is Removed
- ▣ New Set of Coil Packs Replace Wet Wall
- ▣ Free Cooling Below 50°F
- ▣ Cooling Coil Creates Condensation
- ▣ Room Air Dehumidifies via Condensate Drain
- ▣ Warm Coil Reheats Cool Air for Minimal Temperature Change
- ▣ US Patent No. 11,549,696

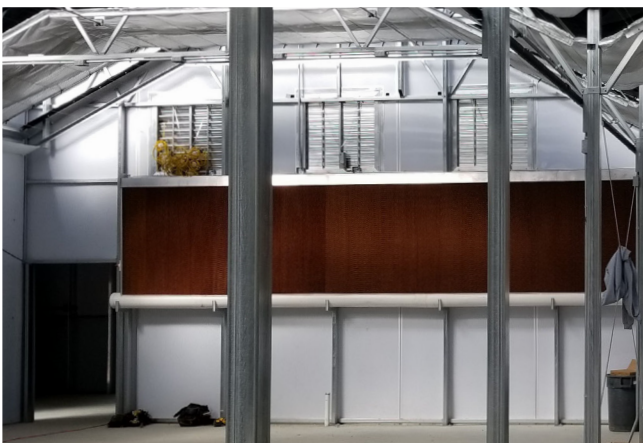

Before



After

© 2021 GROW CONTROLLED, LLC. ALL RIGHTS RESERVED. CONTACT US FOR MORE INFORMATION.



G R O W C O N T R O L L E D , L L C
 100 APPLEWOOD DRIVE SPARTA MICHIGAN · SODUS NEW YORK · UNION GAP WASHINGTON · PADDOCK WOOD UK
 T 616.256.0420 · F 616.887.1128 · INFO@GROWCONTROLLED.COM · GROWCONTROLLED.COM